


# TYPICAL SEISMIC SUSPENSION REQUIREMENTS

LATERAL BRACING: BRACE WITH HANGER WIRES AND STRUTS PER ASTM E-580,  
AND IN ACCORDANCE WITH LOCAL CODE REQUIREMENTS.

(4) #12 GAGE WIRES SPLAYED 90° FROM EACH OTHER AT ANGLE NOT EXCEEDING 45° FROM PLANE OF CEILING. A STRUT FASTENED TO MAIN RUNNER SHALL BE EXTENDED TO AND FASTENED TO STRUCTURE ABOVE. SPLAYED WIRE AND STRUT BRACING TO BE PLACED NOT MORE THAN 12 FEET ON CENTER IN EACH DIRECTION, WITH THE FIRST POINT WITHIN 4 FEET FROM EACH WALL.

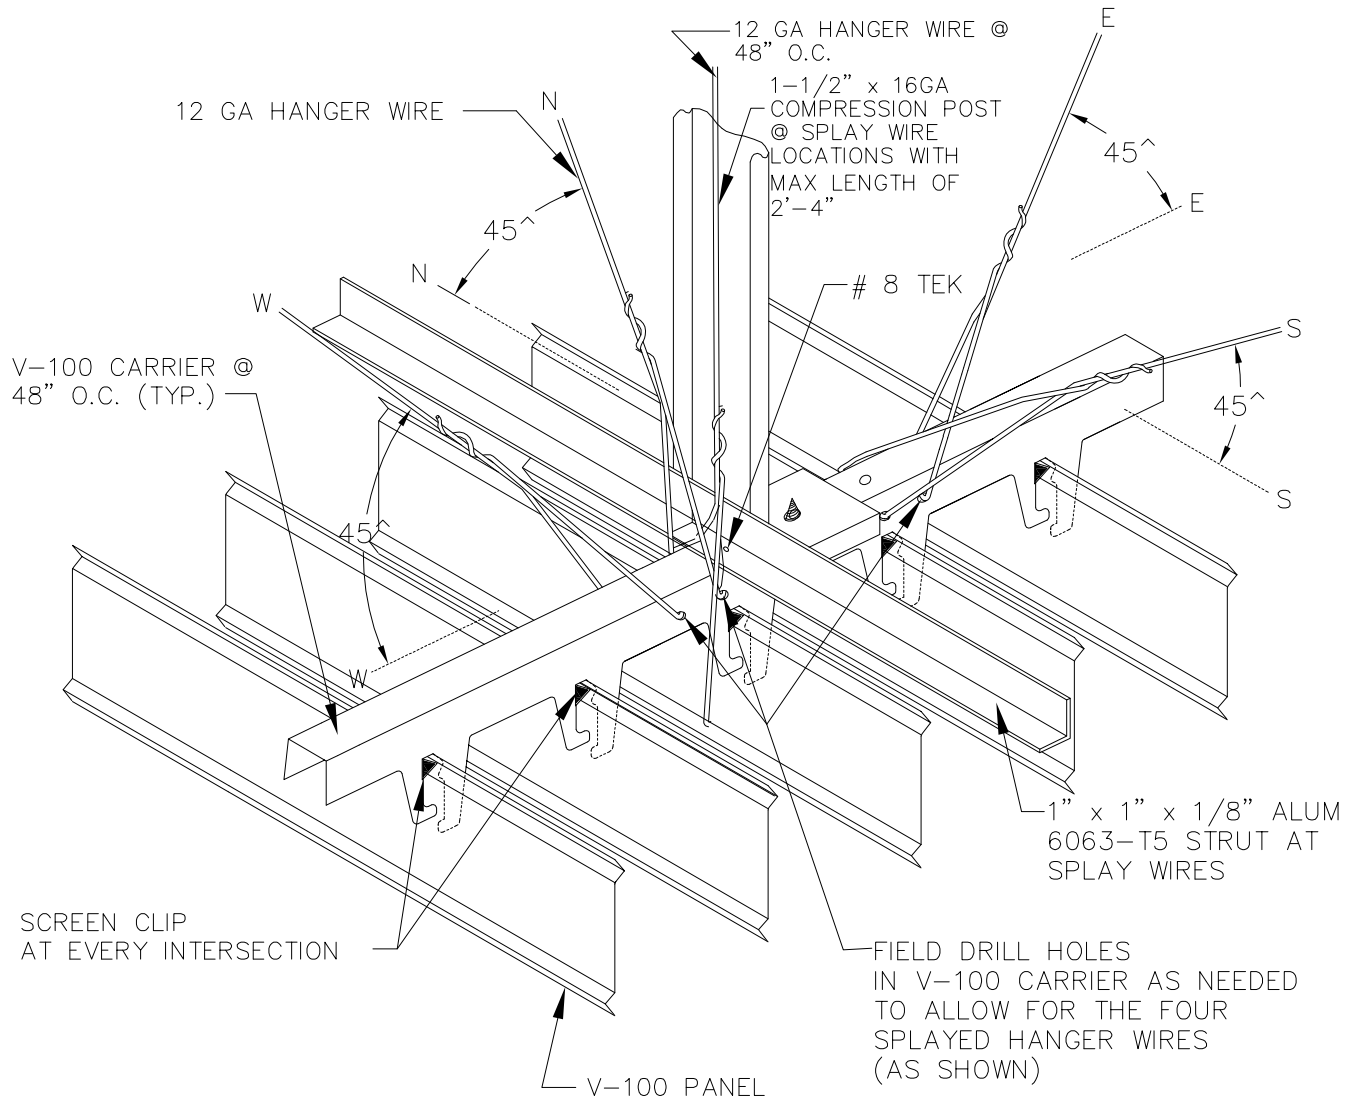

## HunterDouglas®

Architectural Products, Inc.

5015 OAKBROOK PARKWAY, SUITE 100 / NORCROSS, GA 30093  
(770) 806-9557 • (800) 366-4327 • FAX (770) 806-0214

## LUXALON®

A HunterDouglas® PRODUCT

PRODUCT CATEGORY TYPICAL SEISMIC SUSPENSION REQUIREMENTS  
SCALE NTS DWG. #: LT-0414

ALL RIGHTS RESERVED. THIS DRAWING IS THE PROPERTY OF HUNTER DOUGLAS AND MAY BE USED ONLY IN CONJUNCTION WITH CONSTRUCTION PROJECTS UTILIZING HUNTER DOUGLAS PRODUCTS. THIS DETAIL MAY NOT APPLY TO ALL CONDITIONS OR CONSTRUCTION SITUATIONS. FOR NON-TYPICAL CONDITIONS, CONSULT HUNTER DOUGLAS.