


DETAIL 'A'

CARRIER SPAN VARIES DEPENDING ON DESIGN WIND PRESSURE SEE DETAIL B.1.2

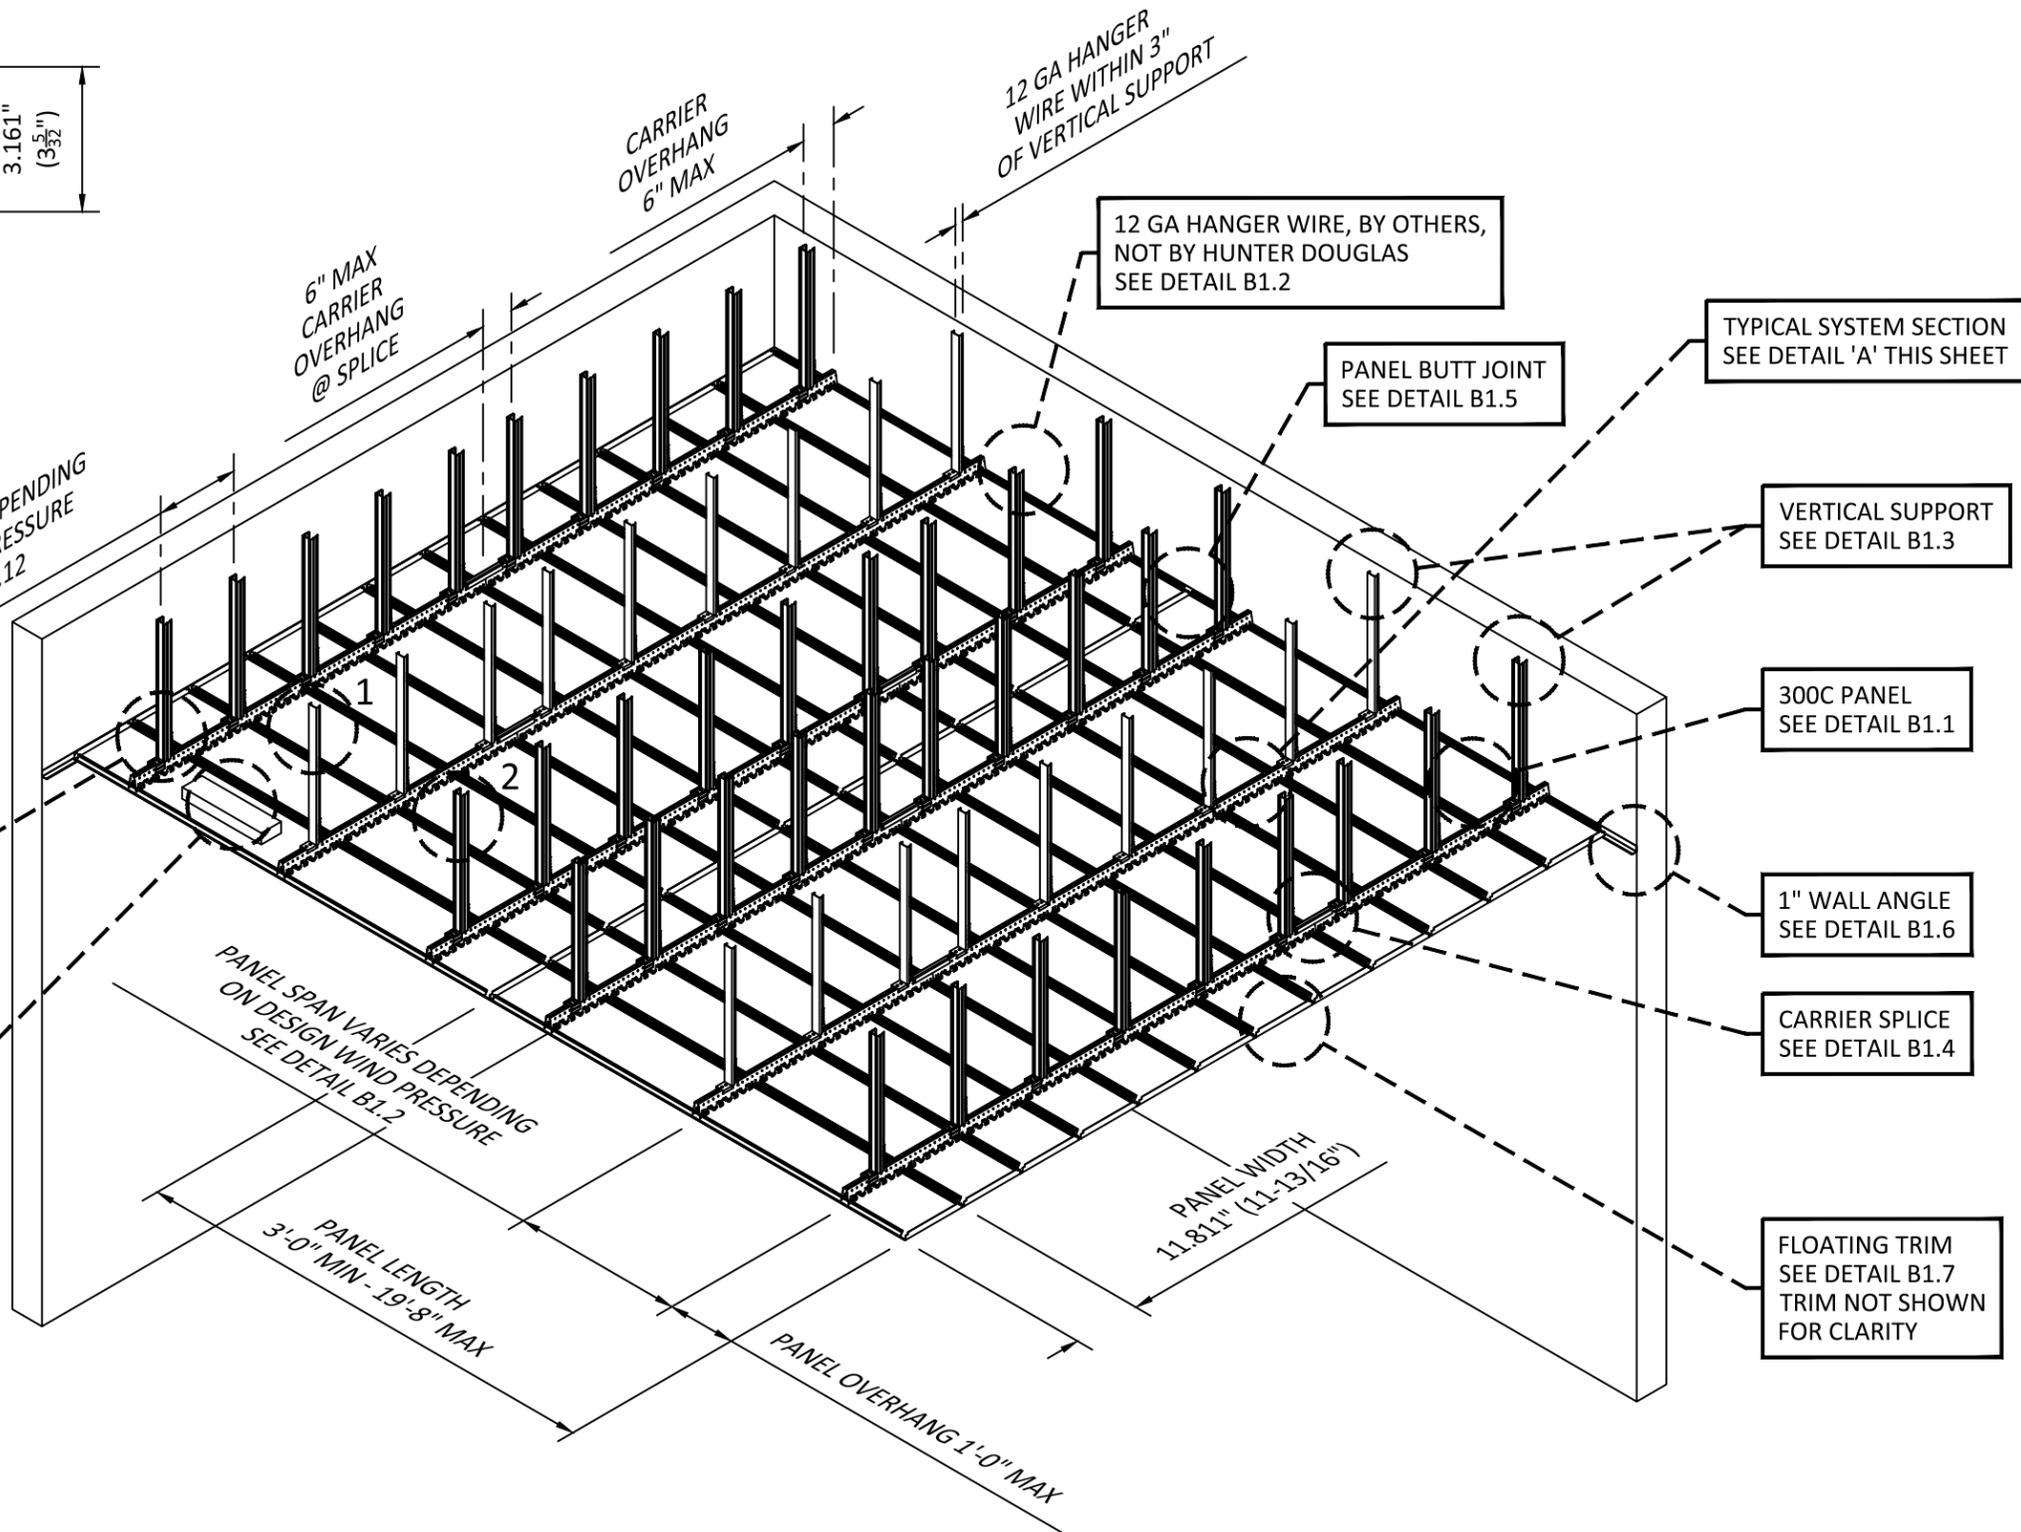

SUSPENSION REQUIREMENTS SEE DETAIL B1.2

SEE DETAILS B1.8 THROUGH B1.11 FOR FIXTURE OPENING RECOMMENDATIONS

- 1** 1/2 X 1-1/2" 16 GA. GALV. CRC
- 2** STE-20 2-1/2" 20 GA GALV. STEEL STUD SEE DETAIL B1.3

EXTERIOR INSTALLATION

HunterDouglasContract

CEILING
 5015 Oakbrook Parkway, Suite 100
 Norcross, GA 30093
 800-366-4327 / 770-806-9557
 fax: 770-806-0214

All rights reserved. This drawing is the property of Hunter Douglas and may not be copied or multiplied neither wholly nor partly. It may not be submitted for perusal to third parties either.
 www.hunterdouglascontract.com

SPECIFICATIONS (unless noted otherwise)	
MATERIAL:	0.028" ALUMINUM 300C PANEL 0.040" ALUMINUM 300C CARRIER
FINISHES:	PAINT / POWDER COAT / DECORATED WOOD FINISH / LUXACOTE
PERFORATION:	#124 (15% OPEN) / NON-PERFORATED



TOLERANCES (unless noted otherwise)	
DECIMAL:	.0 +/- .060 .00 +/- .030 .000 +/- .010
FRACTIONAL:	+/- 1/32"
ANGULAR:	+/- 1/2° (.5°)

OVERALL ISOMETRIC VIEW

PROJECT: 300C PRODUCT SPECIFICATIONS
 DRAWING NUMBER: 300C-B1.0
 PART NUMBER: N/A
 SCALE: 3" = 1'-0"
 DATE: 10/28/16
 DRAWN BY: HDAP ENGINEERING