

12 GA HANGER WIRE, BY
OTHERS, NOT BY HUNTER
DOUGLAS. SEE DETAIL A1.5


SUSPENSION REQUIREMENTS
SEE DETAIL A1.5

PANEL SPECIFICATIONS
SEE DETAIL A1.1

WALL TRIM CONDITIONS
SEE DETAIL A1.6

FIXTURE SPECIFICATIONS
SEE DETAIL A1.7 AND A1.8

INTERIOR INSTALLATION

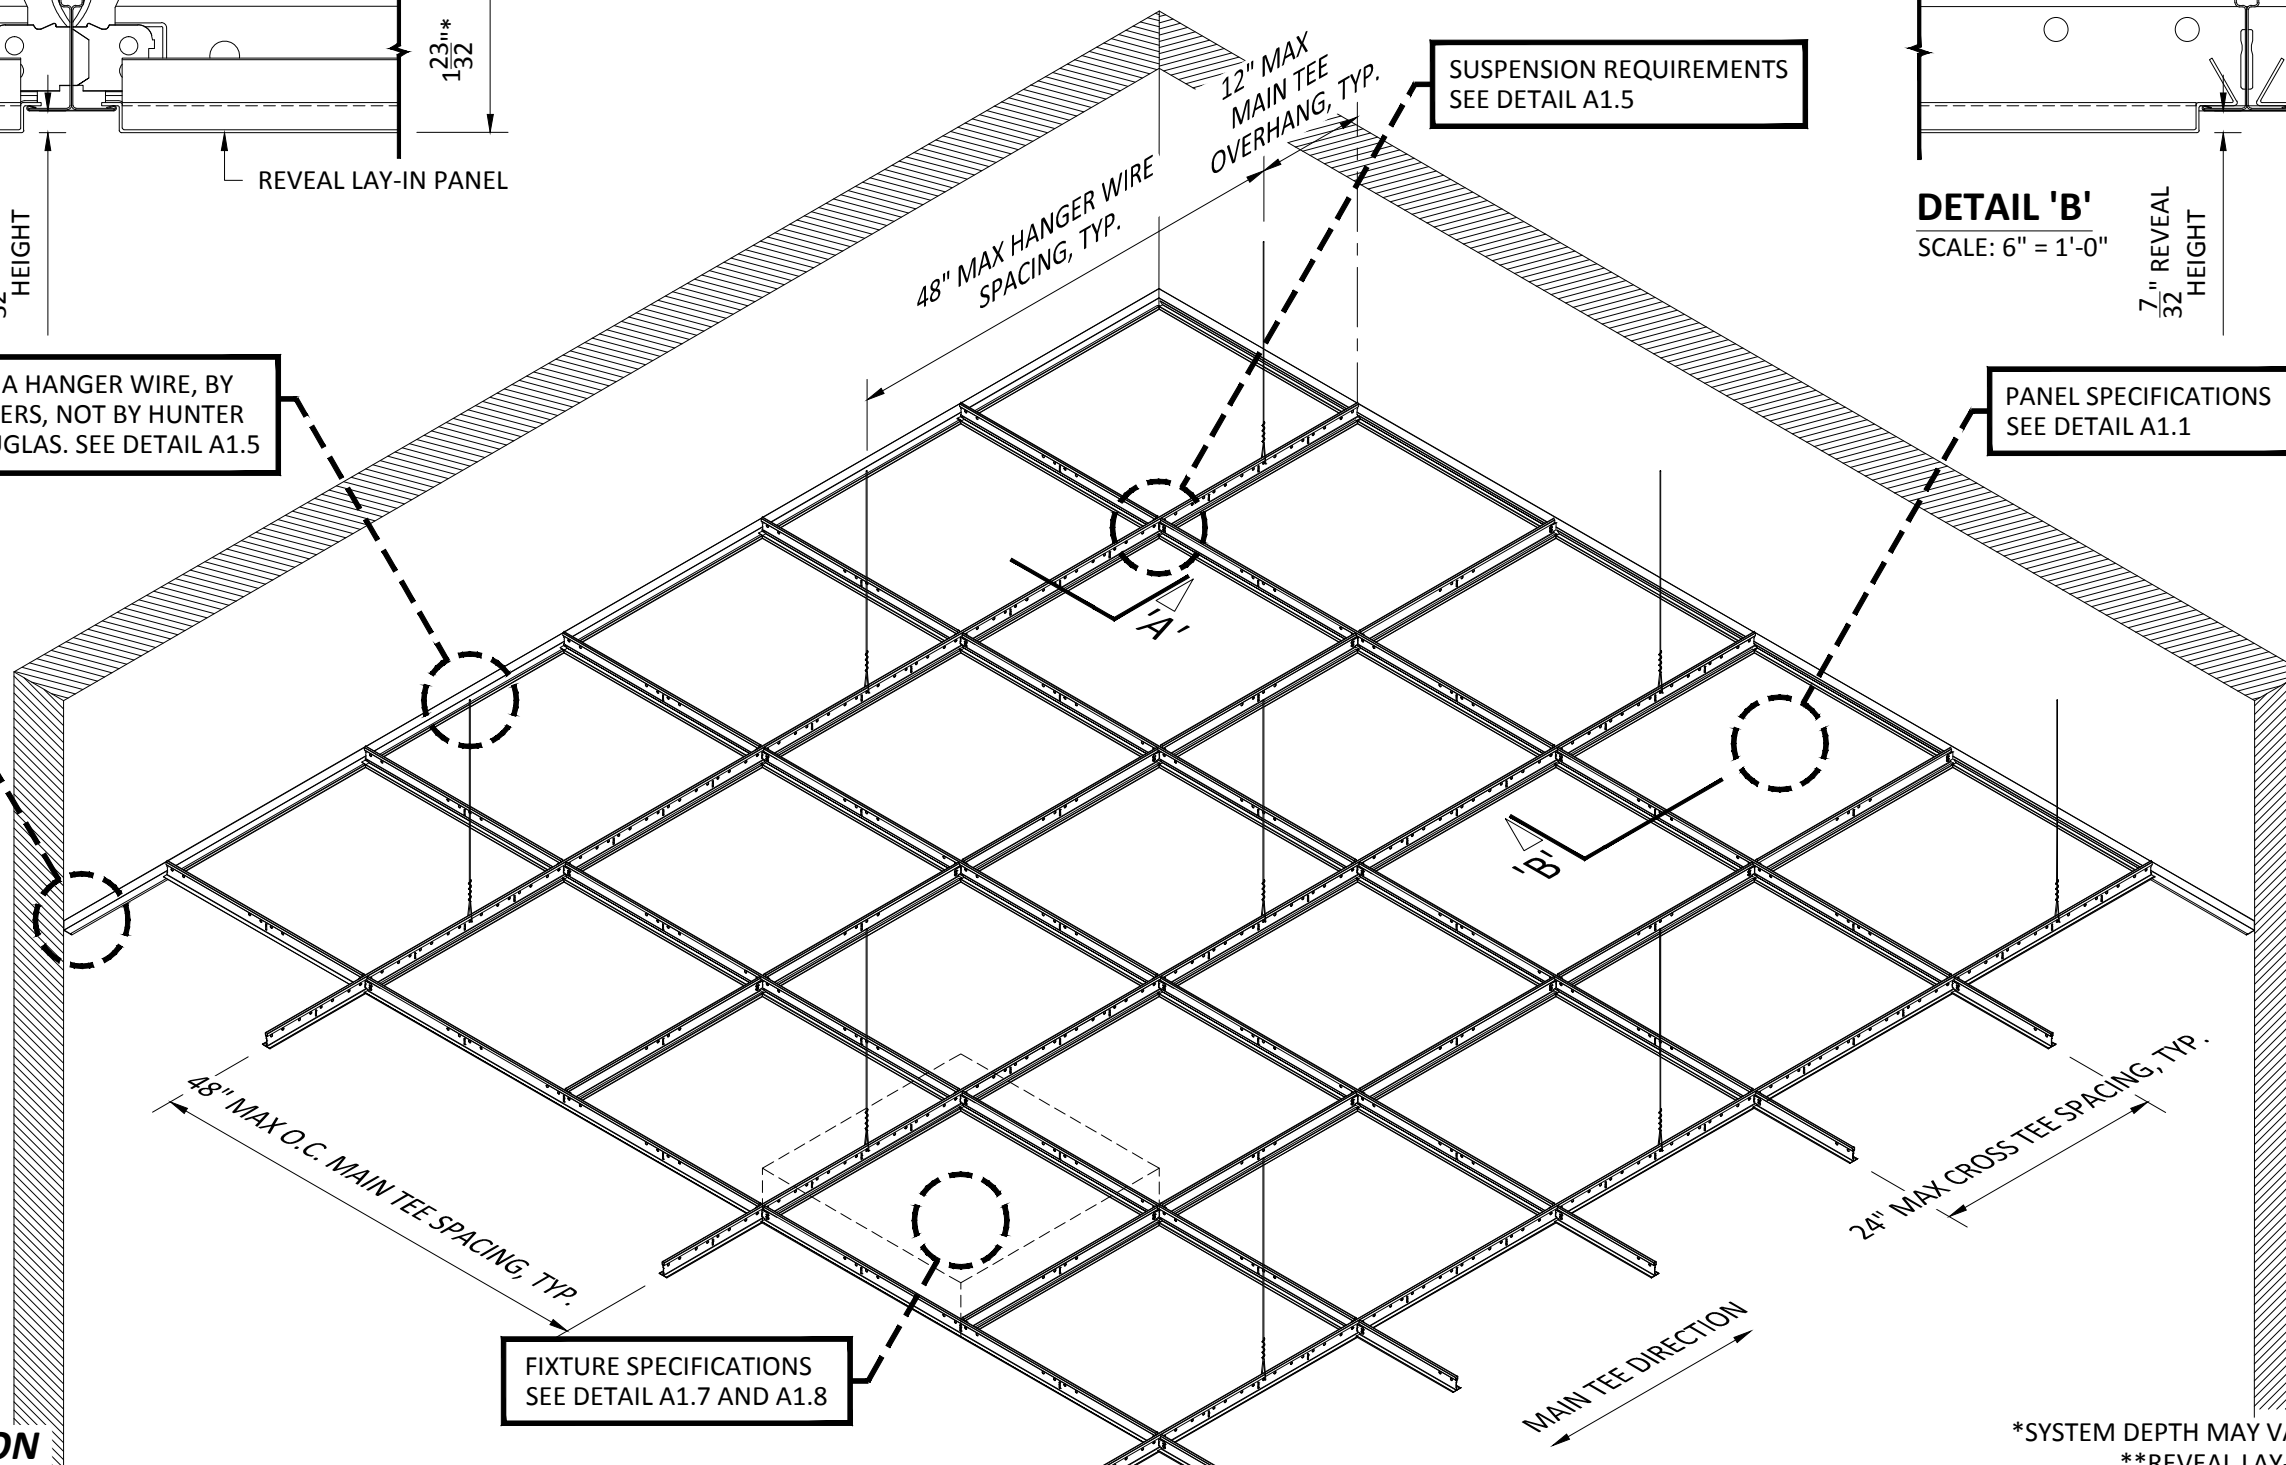

*SYSTEM DEPTH MAY VARY DEPENDING ON HEIGHT OF GRID
**REVEAL LAY-IN PANELS FOR 15/16" GRID SHOWN

HunterDouglasContract

CEILINGS

5015 Oakbrook Parkway, Suite 100
Norcross, GA 30093
800-366-4327 / 770-806-9557
fax: 770-806-0214

All rights reserved. This drawing
is the property of Hunter
Douglas and may not be copied
or multiplied neither wholly nor
partly. It may not be submitted
for perusal to third parties
either.

www.hunterdouglascontract.com

SPECIFICATIONS

(unless noted otherwise)
MATERIAL: 0.032" OR 0.040" ALUMINUM LAY-IN PANEL

FINISH: PAINT / POWDER COAT / DECORATED WOOD FINISH /
WOOD VENEER

PERFORATION: SEE DETAIL A1.1 THIS SET

LUXALON
METAL CEILINGS

WoodWright
WOOD CEILINGS

Techstyle
ACOUSTICAL CEILINGS

TOLERANCES

(unless noted otherwise)

DECIMAL:
.0 +/- .060
.00 +/- .030
.000 +/- .010
FRACTIONAL:
+/- 1/32"
ANGULAR:
+/- 1/2° (.5°)

OVERALL ISOMETRIC VIEW

PROJECT: LAY-IN PRODUCT SPECIFICATIONS
DRAWING NUMBER: LAY-IN-A1.0
PART NUMBER: N/A
SCALE: AS SHOWN
DATE: 8/20/14
DRAWN BY: HDAP ENGINEERING